


GENERAL INFORMATION

- 1) A qualified electrician, in accordance with IEE wiring regulations should carry out connection to mains wiring.
- 2) Electrical Class II luminaire
- 3) Ensure that the rated voltage and frequency requirements are compatible with the available mains supply.
- 4) Cleaning of reflectors and lenses should be carried out using clean, soft and lint free cloths and anti-static cleaning fluid
- 5) Do not carry out high voltage insulation test, i.e. 500/1000v this may damage internal components.
- 6) When installing on floodlight arms, Selise Maxi should be 'underslung' as shown below.

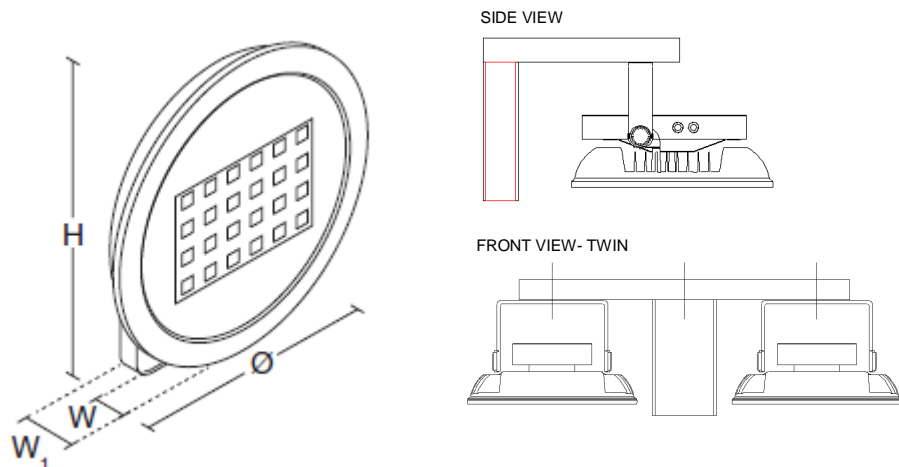

Version.	Dia.	H	W	W ₁	KG
419W	512	524	184	184	17.2
WINDAGE M ² :	0.16				

TECHNICAL SUPPORT
 Telephone: 0161 331 5700
 E-mail: technical@whitecroftlight.com
<http://www.whitecroftlighting.com/>



PK/LEAF/SELMAXIHO

FEB 2021 - Rev B









Whitecroft Lighting Limited

Burlington Street, Ashton-under-Lyne, Lancashire OL7 0AX
 Telephone +44 (0)870 5 087 087 Facsimile: +44 (0)870 5 084 210
 Registered No. 3848973 England Registered Office: As above

SPECIFICATION

Finish	Graphite grey and silver
Materials	Tempered glass / Mild Steel / Aluminium Body
IK Rating	08
Supply	240V AC, 50Hz
Power (High Frequency)	36009 Lumens (419W)
Operating temp	-40 to 35C
Connection	1.5mm2 input
Ingress protection	IP66



FITTING INSTALLATION

Fixing points are the same throughout all verions

